

E-STOP relay, safety gate monitor

up to Category 4, EN 954-1 PNOZ s4




Safety relay for monitoring E-STOP pushbuttons, safety gates and light barriers.

Approvals

PNOZ s4	
	◆
	◆
	◆

Block diagram

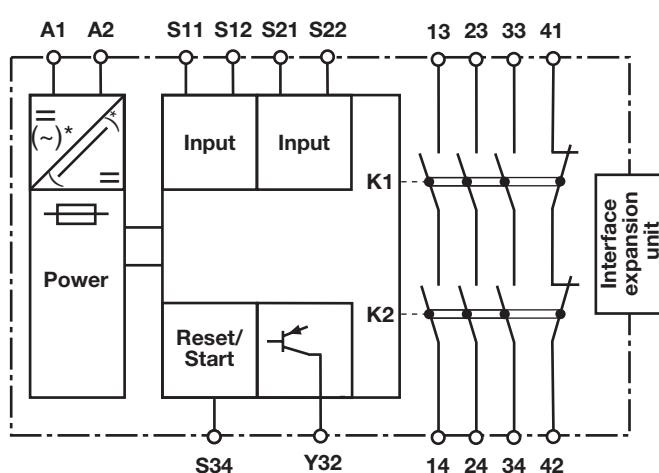

* only when $U_B = 48 - 240$ VAC/DC

up to Category 4, EN 954-1 PNOZ s4


Function description

- ▶ Single-channel operation: no redundancy in the input circuit, earth faults in the reset and input circuit are detected.
- ▶ Dual-channel operation without detection of shorts across contacts: redundant input circuit, detects
 - earth faults in the reset and input circuit,
 - short circuits in the input circuit and, with a monitored reset, in the reset circuit too.
- ▶ Dual-channel operation with detection of shorts across contacts: redundant input circuit, detects
 - earth faults in the reset and input circuit,

- circuit,
- short circuits in the input circuit and, with a monitored reset, in the reset circuit too,
- shorts between contacts in the input circuit.
- ▶ Automatic start: Unit is active once the input circuit has been closed.
- ▶ Manual reset: Unit is active once the input circuit is closed and then the reset circuit is closed.
- ▶ Monitored reset with falling edge: Unit is active once
 - the input circuit is closed and then the reset circuit is closed and opened again.
 - the reset circuit is closed and then opened again once the in-

- put circuit is closed.
- ▶ Monitored reset with rising edge: Unit is active once the input circuit is closed and once the reset circuit is closed after the waiting period has elapsed (see technical details).
- ▶ Reset with start-up test: The unit checks whether safety gates that are closed are opened and then closed again when supply voltage is applied.
- ▶ Increase in the number of available contacts by connecting contact expander modules or external contactors/relays; A connector can be used to connect 1 PNOZsigma contact expander module.

Timing diagram

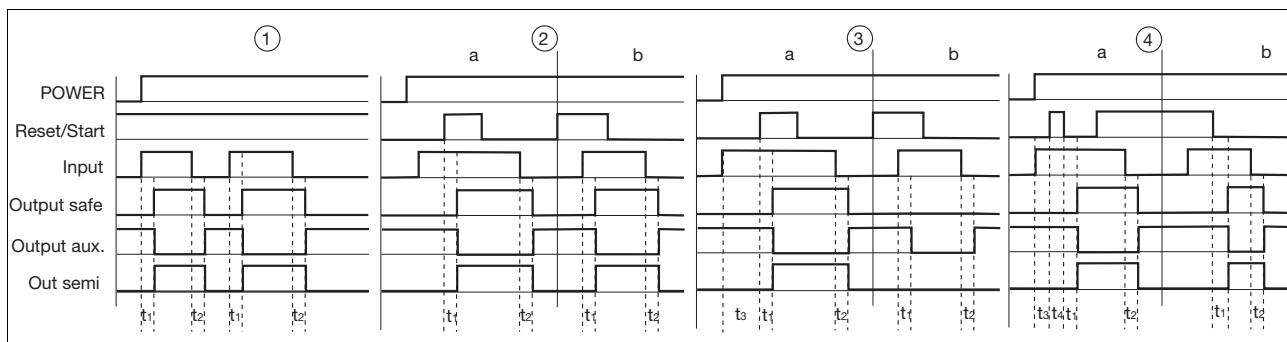

Key

- ▶ Power: Supply voltage
- ▶ Reset/start: Reset circuit S34
- ▶ Input: Input circuits S11-S12, S21-S22
- ▶ Output safe: Safety contacts 13-14, 23-24, 33-34
- ▶ Output aux: Auxiliary contacts 41-42
- ▶ Out semi: Semiconductor output
- ▶ ①: Automatic reset
- ▶ ②: Manual reset
- ▶ ③: Monitored reset with rising edge
- ▶ ④: Monitored reset with falling edge
- ▶ a: Input circuit closes before reset circuit
- ▶ b: Reset circuit closes before input circuit
- ▶ t₁: Switch-on delay
- ▶ t₂: Delay-on de-energisation
- ▶ t₃: Waiting period
- ▶ t₄: Waiting period reset circuit was closed

Wiring

Please note:

- ▶ Information given in the "Technical details" must be followed.
- ▶ Outputs 13-14, 23-24, 33-34 are safety contacts, output 41-42 is an auxiliary contact (e.g. for display).
- ▶ To prevent contact welding, a fuse should be connected before the output contacts (see technical details).
- ▶ Calculation of the max. cable runs I_{max} in the input circuit:

$$I_{max} = \frac{R_{lmax}}{R_l / km}$$

R_{lmax} = max. overall cable resistance (see technical details)

R_l / km = cable resistance/km

- ▶ Use copper wire that can withstand 60/75 °C.
- ▶ Sufficient fuse protection must be provided on all output contacts with capacitive and inductive loads.

E-STOP relay, safety gate monitor

up to Category 4, EN 954-1 PNOZ s4

Preparing for operation

► Supply voltage





Supply voltage	AC	DC

► Input circuit


Input circuit	Single-channel	Dual-channel
E-STOP without detection of shorts across contacts		
E-STOP with detection of shorts across contacts		
Safety gate without detection of shorts across contacts		
Safety gate with detection of shorts across contacts		
Light barrier or safety switch with detection of shorts across contacts via ESPE		

up to Category 4, EN 954-1 PNOZ s4

► Reset circuit/feedback loop

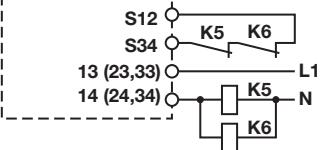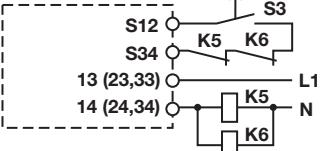Reset circuit/feedback loop	Reset circuit	Feedback loop
Automatic reset		
Manual/monitored reset		

► Semiconductor output

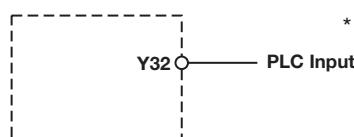

*Connect together the 0V connections on all the external power supplies

INFORMATION


The wiring between a base unit and a PNOZsigma expander module occurs exclusively via the connector.

► Key

S1/S2	E-STOP/safety gate switch
S3	Reset button
↑	Switch operated
↗	Gate open
↘	Gate closed

up to Category 4, EN 954-1 PNOZ s4

Terminal configuration

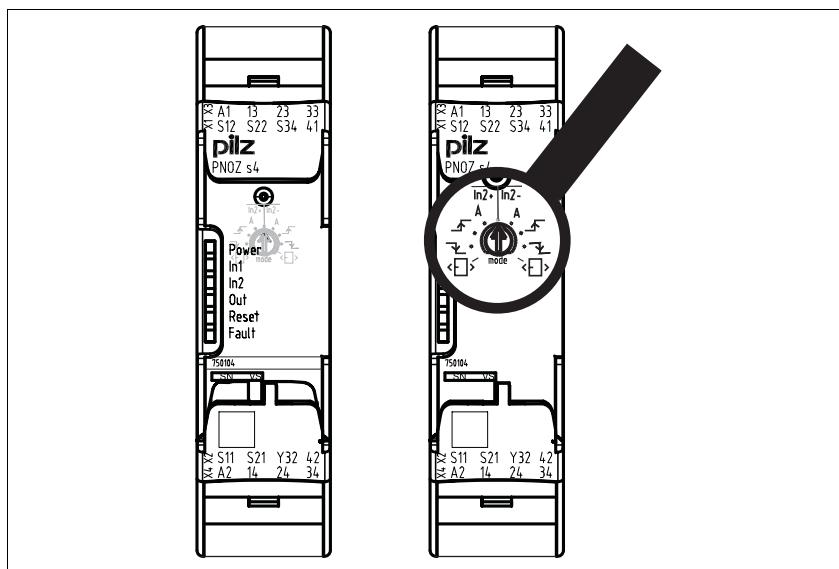

Installation

Install base unit without contact expander module:

- ▶ Ensure that the plug terminator is inserted at the side of the unit.

Connect base unit and PNOZsigma contact expander module:


- ▶ Remove the plug terminator at the side of the base unit and at the contact expander module.
- ▶ Connect the base unit and the contact expander module to the supplied connector before mounting the units to the DIN rail.

Installation in control cabinet

- ▶ The safety relay should be installed in a control cabinet with a protection type of at least IP54.
- ▶ Use the notch on the rear of the unit to attach it to a DIN rail.
- ▶ Ensure the unit is mounted securely on a vertical DIN rail (35 mm) by using a fixing element (e.g. retaining bracket or an end angle).
- ▶ Push the unit upwards or downwards before lifting it from the DIN rail.

Dimensions

* with spring-loaded terminals

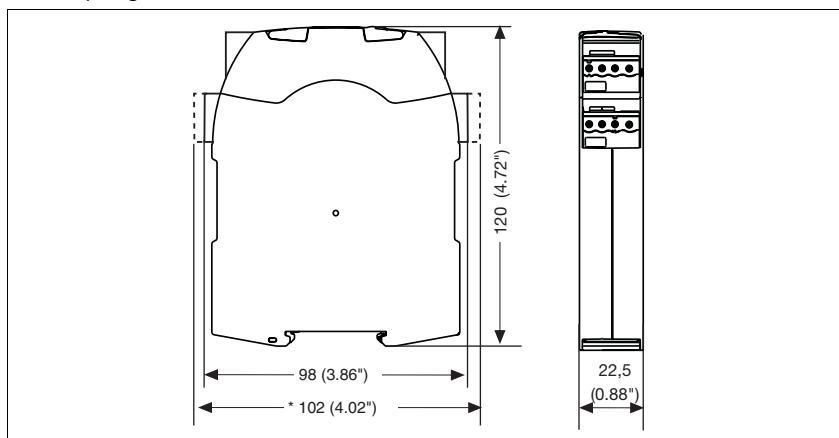

E-STOP relay, safety gate monitor


up to Category 4, EN 954-1 PNOZ s4

Notice


This data sheet is only intended for use during configuration. For installation and operation, please refer to the operating instructions supplied with the unit.

Service life graph

U_B 24 V DC

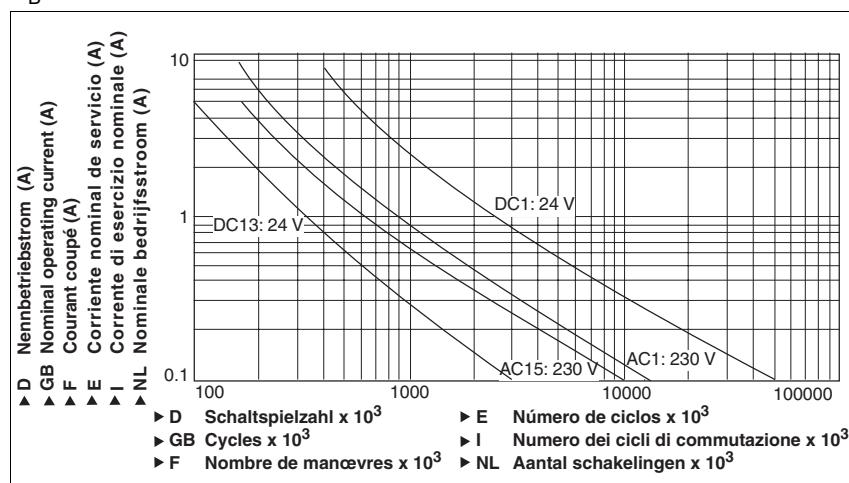

U_B 48-240 VAC/DC

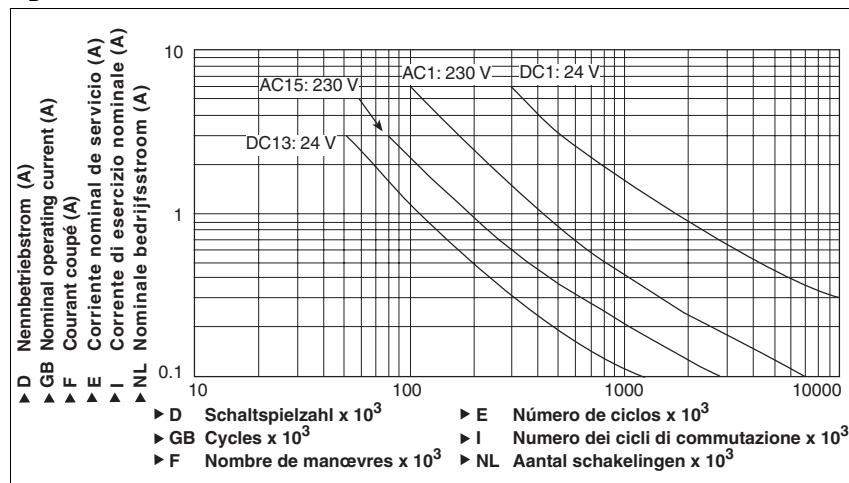

Technical details

Electrical data

Supply voltage	24 V
Supply voltage U_B DC	24 V
Supply voltage U_B AC/DC	48 - 240 V
Voltage tolerance	-15 %/+10 %
Power consumption at U_B AC	5.0 VA Order no.: 750134, 751134
Power consumption at U_B DC	2.5 W
Frequency range AC	50 - 60 Hz
Residual ripple DC	20 %, 160 %
Voltage and current at	
Input circuit DC: 24.0 V	50.0 mA
Reset circuit DC: 24.0 V	50.0 mA
Feedback loop DC: 24.0 V	50.0 mA
Number of output contacts	
Safety contacts (S) instantaneous:	3
Auxiliary contacts (N/C):	1

E-STOP relay, safety gate monitor

up to Category 4, EN 954-1 PNOZ s4

Electrical data

Category of output contacts in accordance with **EN 954-1**

Safety contacts (S) instantaneous:

4

Utilisation category in accordance with **EN 60947-4-1**

Safety contacts: AC1 at **240 V**

I_{min}: 0.01 A, I_{max}: 6.0 A Order no.: 750134, 751134
8.0 A Order no.: 750104, 751104

P_{max}: 1500 VA Order no.: 750134, 751134
2000 VA Order no.: 750104, 751104

Safety contacts: DC1 at **24 V**

I_{min}: 0.01 A, I_{max}: 6.0 A Order no.: 750134, 751134
8.0 A Order no.: 750104, 751104

P_{max}: 150 W Order no.: 750134, 751134
200 W Order no.: 750104, 751104

Auxiliary contacts: AC1 at **240 V**

I_{min}: 0.01 A, I_{max}: 6.0 A Order no.: 750134, 751134
8.0 A Order no.: 750104, 751104

P_{max}: 1500 VA Order no.: 750134, 751134
2000 VA Order no.: 750104, 751104

Auxiliary contacts: DC1 at **24 V**

I_{min}: 0.01 A, I_{max}: 6.0 A Order no.: 750134, 751134
8.0 A Order no.: 750104, 751104

P_{max}: 150 W Order no.: 750134, 751134
200 W Order no.: 750104, 751104

Utilisation category in accordance with **EN 60947-5-1**

Safety contacts: AC15 at **230 V**

I_{max}: 3.0 A Order no.: 750134, 751134
6.0 A Order no.: 750104, 751104

Safety contacts: DC13 at **24 V** (6 cycles/min)

I_{max}: 4.0 A Order no.: 750134, 751134
5.0 A Order no.: 750104, 751104

Auxiliary contacts: AC15 at **230 V**

I_{max}: 3.0 A Order no.: 750134, 751134
6.0 A Order no.: 750104, 751104

Auxiliary contacts: DC13 at **24 V** (6 cycles/min)

I_{max}: 4.0 A Order no.: 750134, 751134
5.0 A Order no.: 750104, 751104

Contact material

AgCuNi + 0.2 µm Au

External contact fuse protection ($I_K = 1 \text{ kA}$) to **EN 60947-5-1**

Blow-out fuse, quick

Safety contacts:

10 A Order no.: 750104, 751104

6 A Order no.: 750134, 751134

Auxiliary contacts:

10 A Order no.: 750104, 751104

6 A Order no.: 750134, 751134

Blow-out fuse, slow

Safety contacts:

4 A Order no.: 750134, 751134

6 A Order no.: 750104, 751104

Auxiliary contacts:

4 A Order no.: 750134, 751134

6 A Order no.: 750104, 751104

Circuit breaker 24 VAC/DC, characteristic B/C

Safety contacts:

4 A Order no.: 750134, 751134

6 A Order no.: 750104, 751104

Auxiliary contacts:

4 A Order no.: 750134, 751134

6 A Order no.: 750104, 751104

Semiconductor outputs (short circuit proof)

24.0 V DC, 20 mA

Max. overall cable resistance R_{lmax}

input circuits, reset circuits

30 Ohm

single-channel at U_B DC

30 Ohm Order no.: 750134, 751134

dual-channel without detect. of shorts across contacts at U_B DC

60 Ohm Order no.: 750104, 751104

dual-channel with detect. of shorts across contacts at U_B DC

30 Ohm

Safety-related characteristic data

Probability of dangerous failure per hour (PFH_D)

Safety contacts, instantaneous

2.31E-09 1/h

SIL claim limit (SIL CL)

Safety contacts, instantaneous

3

E-STOP relay, safety gate monitor

up to Category 4, EN 954-1 PNOZ s4

Safety-related characteristic data

Performance level (PL)

Safety contacts, instantaneous

e

Proof test interval in years

20

Times

Switch-on delay

with automatic reset typ.

170 ms

with automatic reset max.

300 ms

with automatic reset after power on typ.

350 ms

with automatic reset after power on max.

600 ms

with manual reset typ.

40 ms

on monitored reset with rising edge typ.

35 ms

on monitored reset with rising edge max.

50 ms

on monitored reset with falling edge typ.

55 ms

on monitored reset with falling edge max.

70 ms

Delay-on de-energisation

with E-STOP typ.

10 ms

with E-STOP max.

20 ms

with power failure typ.

40 ms

with power failure max.

60 ms

Recovery time at max. switching frequency 1/s

after E-STOP

50 ms

after power failure

100 ms

Waiting period with a monitored reset

with rising edge

120 ms

with falling edge

150 ms Order no.: 750134, 751134

250 ms Order no.: 750104, 751104

Min. start pulse duration with a monitored reset

with rising edge

30 ms

with falling edge

100 ms

Simultaneity, channel 1 and 2

∞

Supply interruption before de-energisation

20 ms

Environmental data

EMC

EN 60947-5-1, EN 61000-6-2, EN 61000-6-4

Vibration to EN 60068-2-6

Frequency

10 - 55 Hz

Amplitude

0.35 mm

Climatic suitability

EN 60068-2-78

Airgap creepage

EN 60947-1

Rated insulation voltage

250 V

Rated impulse withstand voltage

4.0 kV

Ambient temperature

-10 - 55 °C

Storage temperature

-40 - 85 °C

Protection type

Mounting (e.g. cabinet)

IP54

Housing

IP40

Terminals

IP20

Mechanical data

Housing material

Housing

PC

Front

PC

Max. cross section of external conductors with screw terminals

1 core flexible

0.25 - 2.50 mm², 24 - 12 AWG Order no.: 750104, 750134

2 core, same cross section, flexible:

with crimp connectors, without insulating sleeve

0.25 - 1.00 mm², 24 - 16 AWG Order no.: 750104, 750134

without crimp connectors or with TWIN crimp connectors

0.20 - 1.50 mm², 24 - 16 AWG Order no.: 750104, 750134

Torque setting with screw terminals

0.50 Nm Order no.: 750104, 750134

up to Category 4, EN 954-1 PNOZ s4

Mechanical data

Max. cross section of external conductors with cage clamp terminals/spring-loaded terminals: Flexible without crimp connectors	0.20 - 2.50 mm², 24 - 12 AWG Order no.: 751104, 751134
Cage clamp terminals/spring-loaded terminals: Terminal points per connection	2 Order no.: 751104, 751134
Stripping length	9 mm Order no.: 751104, 751134
Dimensions	
Height	102.0 mm Order no.: 751104, 751134 96.0 mm Order no.: 750104, 750134
Width	22.5 mm
Depth	120.0 mm
Weight	190 g Order no.: 750104, 751104 210 g Order no.: 750134, 751134

Conventional thermal current

Number of contacts	I _{th} (A) at U _B DC	I _{th} (A) at U _B AC
1	6.00 A Order no.: 750134, 751134 8.00 A Order no.: 750104, 751104	6.00 A Order no.: 750134, 751134
2	6.00 A	6.00 A Order no.: 750134, 751134
3	4.50 A Order no.: 750134, 751134 5.00 A Order no.: 750104, 751104	4.50 A Order no.: 750134, 751134

Order reference

Type	Features	Terminals	Order no.
PNOZ s4	24 VDC	With screw terminals	750 104
PNOZ s4 C	24 VDC	With spring-loaded terminals	751104
PNOZ s4	48 – 240 VAC/DC	With screw terminals	750134
PNOZ s4 C	48 – 240 VAC/DC	With spring-loaded terminals	751 134